





#### **FEATURES**

- MODULAR PROCESS CONNECTION SYSTEM WITH ELASTOMER-FREE SEALING CONE
  - HIGH PRECISION 0.05% FS, TURN DOWN 10, VACUUM SAFE
  - OPTIONAL WITH HART® PROTOCOL
  - TANK LINEARISATION FOR STANDARD TANK SHAPES AND SPECIAL DESIGNS THANKS TO VOLUMETRIC MEASUREMENT
  - DIAGNOSIS FUNCTION FOR MONITORING OF DEVICES
  - COPYING OF DEVICE PARAMETERS WITH EASY TRANSFER
  - INTEGRATED ON-SITE DISPLAY OR EXTERNAL OPUSi DISPLAY AND OPERATING MODULE FOR PARAMETRISATION AND DISPLAY OF MEASURING VALUES
  - APPLICATION STRENGTHS: MEASUREMENT OF CONTENT OF PRESSURISED TANKS / VACUUM MEASUREMENTS WITH HIGH TEMPERATURES

#### **DESCRIPTION**

The PZT pressure transmitters are suitable for taking pressure and filling level measurements in pipelines and containers. The modular process connection system offers a wide range of connection adapters and helps to cut costs in the long term. The flush-mounted process connection with elastomer-free sealing cone is predestined for measurements which satisfy even the most stringent hygiene requirements.

The vacuum-proof measuring cell with stainless steel membrane works on the basis of the piezoresistive measuring principle The PZT pressure transmitters are designed to measure from -1/0...0.35 to -1/0...100bar. Special measuring ranges are also available on request. Given the nature of the design for long-term medium temperatures of up to 125°C / 200°C, CIP and SIP cleaning methods can be used on the transmitters. The high protection classes of IP67 and IP69K also mean that the devices can be safely cleaned on the outside with foam and a high-pressure cleaner and that moisture is reliably prevented from entering into the device. For additional protection against moisture, the electronics are fully encapsulated in the housing.



All the pressure transmitters in series 200/201 are highly precise and have been developed for difficult tank content measurements and, in particular, for applications with constantly high temperatures of up to 200°C. Furthermore, using the on-site display with series 200 and the display and operating module OPUS *i* in series 201, the pressure transmitters can be simply read out, configured and diagnosed. With the EASY TRANSFER function, the configuration data can be copied via the OPUS*i* module onto other pressure transmitters in series 201. This makes commissioning easier for the same applications. The option of programming in tank dimensions for standard tank designs as well as for special tanks using the volumes calculated by means of volumetric measurement means exact filling levels and tank content can be shown directly.

In addition to the features of the 200/201 series, the pressure transmitters in the 200H/201H series boast an integrated HART<sup>®</sup> modem. This also enables remote configuration and evaluation of the transmitters using the HART<sup>®</sup> protocol.

#### **TECHNICAL DATA**


General details					
Device type / measuring principle	PIEZOTEC PZT 200/201/2	200H/201H <sup>,</sup> piezoresistive			
Input	1120120121200/201/				
Measuring ranges		PZT 200/201/200H/201H			
Standard nominal measuring		FZT 200/20			
ranges [bar]	relative	OP	absolute	OP	
OP = overload protection [bar]	00.35	1			
	01	3	01	3	
	-1/02.5	8	02.5	8	
Special measuring ranges are	-1/05	15	05	15	
available on request.	-1/010	30	010	30	
All measuring cells are vacu-	-1/030	90	030	90	
um-proof	-1/0100	250	0100	250	
Setting the measuring ranges	Via the keypad of the OPUS <i>i</i> display and operating module / via the integrated on-site display Optional: via HART <sup>®</sup>				
Setting ranges	Start the measuring zero: Measuring span span:		sor's nominal measuring span ensor's nominal measuring span	TD=10	
Burst pressure DIN16086	≥ 4-fold measuring range				
Output					
Output signal	2-wire: 420mA with a test circuit connection in the device Optional: 420mA HART®				
Fault signal	Optional: 3.8mA, 22mA, hold (i.e. holding the last value)				
Current limitation	3.85mA and 21.5mA (normal operation)				
Integration time	Continuously selectable between 0 and 300 s (setting time after a pressure leap)				
Measuring accuracy					
Reference conditions	acc. to DIN IEC 770				
Linearity, hysteresis and repeata- bility as per the limit point method DIN IEC 770	$\leq \pm 0.05\%$ of the sensor's nominal measuring range				
Activation time	< 5s (the device will carry	out a self-test.)			
Setting time (without damping)	< 200ms				
Long-time drift	≤ 0.2% of the span per ye	ar			
Thermal hysteresis	$\leq \pm 0.2\%$ of the sensor's nominal measuring range / 10K (-20 to +80°C) from 4bar $\leq \pm 0.3\%$ of the sensor's nominal measuring range / 10K (-20 to +80°C) up to 0.6bar				
Conditions of use					
Installation position / calibration position	Any position / standing vertically (position-dependent zero point displacement)				
Medium temperature	T1: -40+125°C (140°C over one hour at the most) T2: -40+200°C (high-temperature version)				
Ambient storage temperature	Type 201/201H:-40+85°CType 200/200H:-30+75°C(Below -20°C cable breakage might occur and the display's function may be impaired.)				
Protection class acc. to EN60529	IP 67 and IP 69K				
Electromagnetic compatibility	Sensitivity against interference radiation:	ence: acc. to DIN IEC 610 acc. to DIN IEC 6100			



## **TECHNICAL DATA**

Construction			
Electrical connection	<ul> <li>Standard: cable screw connection M16x1.5, nickel-plated brass, stainless steel available on request</li> <li>Optional: round plug-in connector M12x1, nickel-plated brass, stainless steel available on request</li> <li>Optional: angle plug acc. to EN 175301-803</li> <li>Optional: reference cable</li> </ul>		
Process connection	<ul> <li>Membrane, flush-welded on the front, CrNiSt, other materials available on request</li> <li>press screw M38x1.5 and elastomer free sealing cone</li> </ul>		
Materials	- Field housing / lid:       CrNiSt 1.4301 (304)         - Housing seal:       FPM (Viton®)         - Pressure compensation element:       polyamide         - Inspection gauge (type 200/200H):       polycarbonate         - Process connection / connection adapter:       CrNiSt 1.4404 (316L)         - Process membrane:       CrNiSt 1.4435/1.4404 (316L)         - Locking screw (type 201/201H):       CrNiSt 1.4301 (304)         - Reference cable: 5-wire with reference tube:       PUR (recommended: 80m maximum)		
Filling fluid	- Silicon oil (FDA)		
Display and operation			
Display	LCD, 4-digit numerical display and 5-digit alphanumerical display Type 200/200H: integrated on-site display (cannot be separated from device) Type 201/201H: external OPUS <i>i</i> display and operating module		
Displayable units	Pressure:       mbar, bar, psi, Pa, mH <sub>2</sub> O, mmHg, Torr, atm, at, kg/cm <sup>2</sup> Temperature:       °C, °F, K, °R, °Ré         Volume:       I, hI, dm³, m³, ft³, US gal, UK gal, US bI, UK bI         Mass:       kg, t, lbs, tn. sh., tn. I.		
Additional displays	Output current in mA or % (in relation to the span)		
Operation	200/200H:       via the configuration menu with the integrated on-site display         201/201H:       via the configuration menu with the external OPUSi display and operating module		
Auxiliary energy resources			
Power supply / burden	1236V DC, max. burden: (Vsupply – 12V) / 24mA, with HART® resistance min. 18V DC		
Accessories 200 series			
OPUS <i>i</i> display and operating module	external display and operating module, CrNiSt, IP 67, 41x70mm, 1m connection cable and M12x1 round plug-in connector, integrated memory for the parameter transfer to other devices (downwardly compatible with existing devices of the 100 series, but without a copying function between the transmitter and the display and operating module)		
Certificates	Calibration certificate Declaration of conformity Material inspection certificates as per EN 10204		
Process connection adapter	See order information		


#### DIMENSIONED DRAWINGS (dimensions in mm)

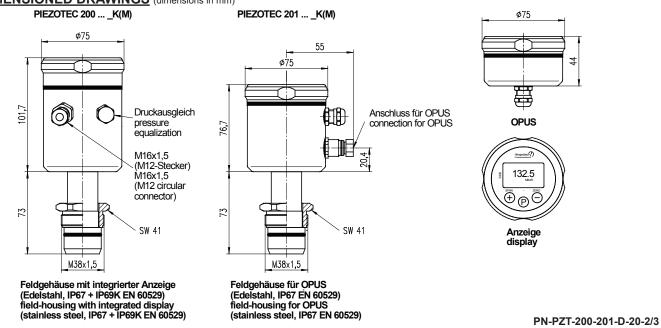




## DIMENSIONED DRAWINGS (dimensions in mm)


Prozessanschlussadapter: (weitere Ausführungen auf Anfrage) adapters for process-connection: (other constructions on request)




PVA6FPZT VARIVENT-Flansch Ø68 VARIVENT-flange Ø68




PBS...FPZT Bundstutzen DIN 11864-1 Form A; DN40, DN50 collar nozzle DIN 11864-1 form A; DN40, DN50




PDR6FPZT DRD-Flansch Ø65 DRD-flange Ø65



PBS4LPZT Bundstutzen DIN 11864-1 DN40, mit 3 Leckagebohrungen collar nozzle DIN 11864-1 DN40, with 3 leakage drills



PCL5FPZT Clamp DIN 32676 - DN50




PMN...FPZT Kegelstutzen DIN 11851 conical nozzle DIN 11851 DN40, DN50



### **ELECTRICAL CONNECTION**

The standard electrical connection is via a cable screw connection M16x1.5. On removing the device lid, the connection is created using screw terminals. The connection diagram in the transmitter head can be seen in the figure below (figure shows the connection for a type 200H/201H device with HART<sup>®</sup>):




The supply voltage is connected via the two terminals 1 (+) and 2 (-). The current flowing in this loop represents the existing measuring value.

The terminals **TE** and **ST** provide a test circuit connection with which the actual loop current can be measured without interruption using an ammeter.

An operating device can be connected to terminals **HA** and **RT** for on-site communication via the **HART**<sup>®</sup>protocol. An additional communication resistor can be added via a sliding switch.


The ground terminal is for potential equalisation between the measuring device and the measuring point.

Alternative connection options are a round plug-in connector M12x1, an angle plug acc. to EN 175301-803 as well as a factory-fitted reference cable with integrated vent capillary. The reference cable comes in lengths of between 1...80m.# The electrical configurations are listed in the following:

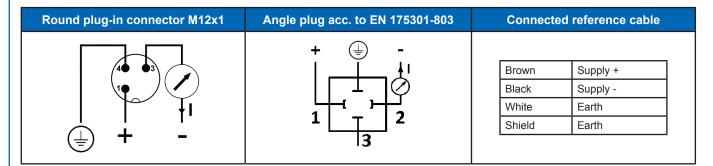

### **CONNECTION FOR HART® COMMUNICATION**

For communication via the HART<sup>®</sup> protocol a minimum burden resistor of 250Ω is required. The following figures show the various options for correct connection. The transmitters can be parametrised via the HART<sup>®</sup> protocol using universal and pressure transmitter-specific common practice commands.

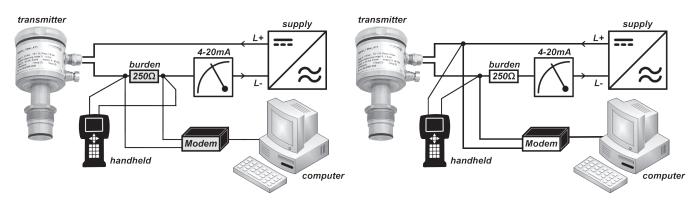



## **CALIBRATION / SETTING**


Factory configuration	
Measuring range calibrated:	Nominal measuring range or as per the order data
Current output:	420mA with extended span between 3.9 and 21mA
Damping:	0s
Mains frequency:	50Hz
Measuring value / measuring unit	Pressure / mbar
Current output in the event of a fault:	hold (last value is held)

#### Configuration menu / parameter list (basic settings of the first parameter level)

No.	Parameter	Explanation
P-O Ofset	Offset	This parameter is used for setting the beginning of the measuring range. The value, which is set here, is assigned the output current of 4mA. The adjustable range is between 090% of the sensor's nominal measuring range.
P-1 SPRN	Span	The span sets the end value for the measuring range. The value, which is set here, represents an output current of 20mA. The adjustable range is within 10100% of the sensor's nominal measuring range.
с.q TUO I	Output current	The current range of 420mA can by inverted if required. The beginning of the measuring range, in its invert- ed state, corresponds to 20mA, and the end of the measuring range to 4mA accordingly.
Р3 ]]АМР	Damping	If the pressure conditions vary heavily, the measuring value can be settled by activating the damping function.
р.ч MRINS	Mains frequency	The setting of the mains frequency, which is used at the respective operating location, serves to suppress any interference inside the device. This way, the mains noise of the power supply unit can be cut out to a large extent.
P-S UNIT	Measuring unit	This setting is used for selecting between different measuring units depending on the measuring value (pres- sure, temperature, volume, mass), which is currently displayed.
P-6 DISPL	Measuring value	This parameter allows the selection of the displayed measuring value. Depending on the device configuration, you can choose between the pressure, temperature, current, percentage, volume or mass.
P-7 BIAS	Inlet pressure	A possible offset pressure, which should not be included in the measuring result, can be hidden by entering an inlet pressure / bias. This is particularly useful for volume measurements in pressurised tanks.
P-8 SYSTM	System	In the system level you can change basic settings of the device, e.g, linearisation, current simulation etc.
P-9 INFO	Information	This information menus provides details on the device's various parameters. These serve, amongst other things, to aid diagnoses and, in the case of faults, with troubleshooting.

### Configuration menu / parameter list (basic settings of the first parameter level)





externes Bedienmodul OPUS external operation module OPUS Parametrisation of the transmitter as well as of the measuring value display on site is handled by the on-site display integrated in the device (type 200/200H) or via the OPUS*i* display and operating module (type 201/201H) located in external housing.

Parameter data can be exchanged between

the series 200 devices via the OPUS*i*. Operation and the measuring value display functions are also guaranteed in devices from earlier series thanks to the downward compatibility of OPUS*i*.



## **ORDER INFORMATION for PIEZOTEC (PZT)**

Electronics	-			
200	420mA, integrated LCD display, TD 10			
201	420mA, can be operated with OPUSi, TD 10			
200H	420mA, HART <sup>®</sup> protocol, integrated LCD display, TD 10			
201H	420mA, HART® protocol, can be operated with OPUS <i>i</i> , TD 10 Sensor's measuring range / pressure type			
	C 0.35bar max. overload 1bar			
	E 1bar max. overload 3bar			
	G 2.5bar max. overload 8bar			
	J 5bar max. overload 15bar			
	K 10bar max. overload 30bar			
	M 30bar max. overload 90bar			
	Q 100bar max. overload 250bar			
	R Relative pressure, overpressure (0xxx bar)			
	N Relative pressure, vacuum (-1xxx bar)			
	A Absolute pressure			
	Electrical connection			
	K Cable screw connection M16x1.5			
	M Round plug-in connector M12x1			
	R05 Reference cable, 5 m, securely fixed			
	R10 Reference cable, 10m, securely fixed			
	R15 Reference cable, 15m, securely fixed			
	R20 Reference cable, 20m, securely fixed			
	R25 Reference cable, 25m, securely fixed			
	RXX Reference cable, length in excess of 20m is to be stated in plain text (max. 80m)			
	Run options			
	T1 Normal temperature option			
	T2 High temperature option for medium temperatures of up to 200°C			
T	Nominal measuring range if differ- ent from sensor's measuring range			



## **ORDER INFORMATION for PIEZOTEC PZT accessories**

Process connection adapter (please order separately)	Article number
Clamp DIN 32676, DN50, 1.4404 (316L)	Z-PCL5FPZT
DRD flange Ø 65 mm, 1.4404 (316L)	Z-PDR6FPZT
Conical coupling with a groove union nut DIN 11851, DN40, 1.4404 (316L)	Z-PMN4FPZT
Conical coupling with a groove union nut DIN 11851, DN50, 1.4404 (316L)	Z-PMN5FPZT
Conical coupling with a groove union nut DIN 11851, DN65, 1.4404 (316L)	Z-PMN6FPZT
Male thread DIN 11851, DN40, 1.4404 (316L)	Z-PMG4FPZT
Male thread DIN 11851, DN50, 1.4404 (316L)	Z-PMG5FPZT
Female thread with a groove union nut DIN 11864-1, DN40, 1.4404 (316L)	Z-PBS4FPZT
Female thread with a groove union nut DIN 11864-1, DN40, with 3 leakage drills, 1.4404 (316L)	Z-PBS4LPZT
Female thread with a groove union nut DIN 11864-1, DN50, 1.4404 (316L)	Z-PBS5FPZT
VARIVENT® flange Ø 68 mm, DN40-125, 1.4404 (316L)	Z-PVA6FPZT
VARIVENT® flange Ø 68 mm, DN40-125, with 3 leakage drills, 1.4404 (316L)	Z-PVA6LPZT
Other process connections	available on request.

Accessories/assembly parts (please order separately)	Article number
OPUSi external operating module, for 201/201H, electronics, 1.4301 (304)	OPUSi
O-ring 28x2.5 made of EPDM (FDA)	Z-POR1FPZM
DRD weld-in block flange DRD, 1.4435 (316L)	Z-PBF9FDRD
Flat seal made of ePTFE for DRD flange (FDA)	Z-FLD ePTFE DRD
4 x fastening screws for DRD flange, 1.4301 (304)	Z-ZDRDSK10/20
Reference cable made of PUR with pressure compensation capillary (please specify length in m)	BT-RK DTM
Approval certificate 3.1 acc. to EN 10204 for material composition	Z-WZ31-3.1_M01
Approval certificate 3.1 acc. to EN 10204 for surface quality ≤ 0.8µm or standard	Z-WZ31-3.1_OF1
Certificate of compliance 2.1 acc. to EN 10204	Z-WZ21-2.1
Test report 2.2 acc. to EN 10204	Z-WZ22-2.2

Please observe the permissible nominal pressure of the process connection selected. All specifications and certifications specified are only guaranteed when Hengesbach original components are used. Our devices are subject to constant development; subject to technical modification.